



REV	DESCRIPTION	BY	DATE	CHKD
1	ISSUED FOR REG'D		1/9/95	
2				
3				
4				

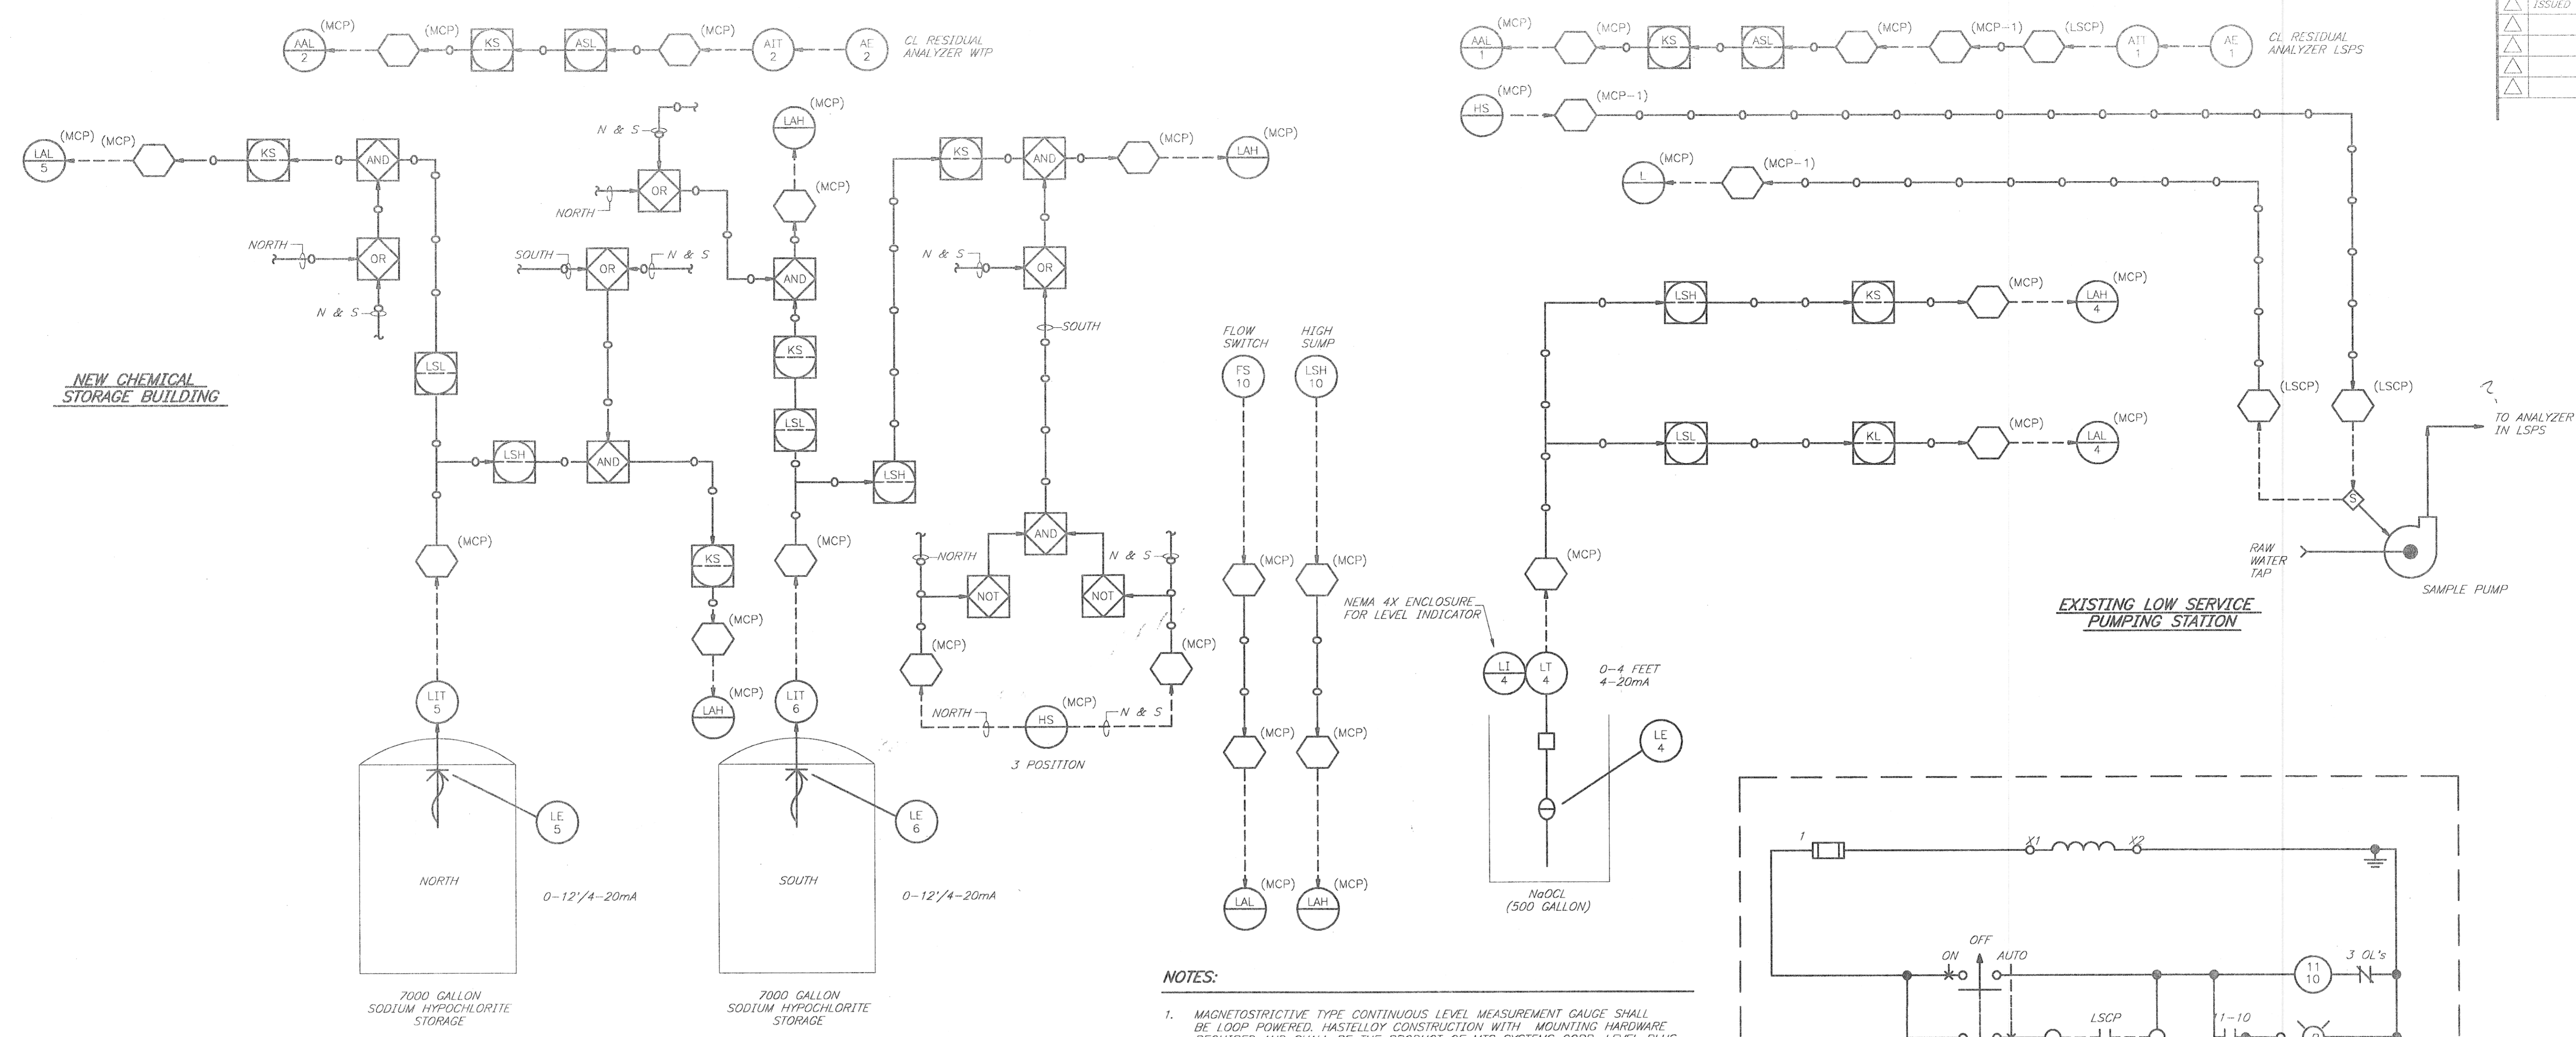


NOTES:



1. MAGNETOSTRICTIVE TYPE CONTINUOUS LEVEL MEASUREMENT GAUGE SHALL BE LOOP POWERED, HASTELLOY CONSTRUCTION WITH MOUNTING HARDWARE REQUIRED AND SHALL BE THE PRODUCT OF MTS SYSTEMS CORP. LEVEL PLUS. COORDINATE SPECIFIC GRAVITY OF FLOAT WITH MANUFACTURER.

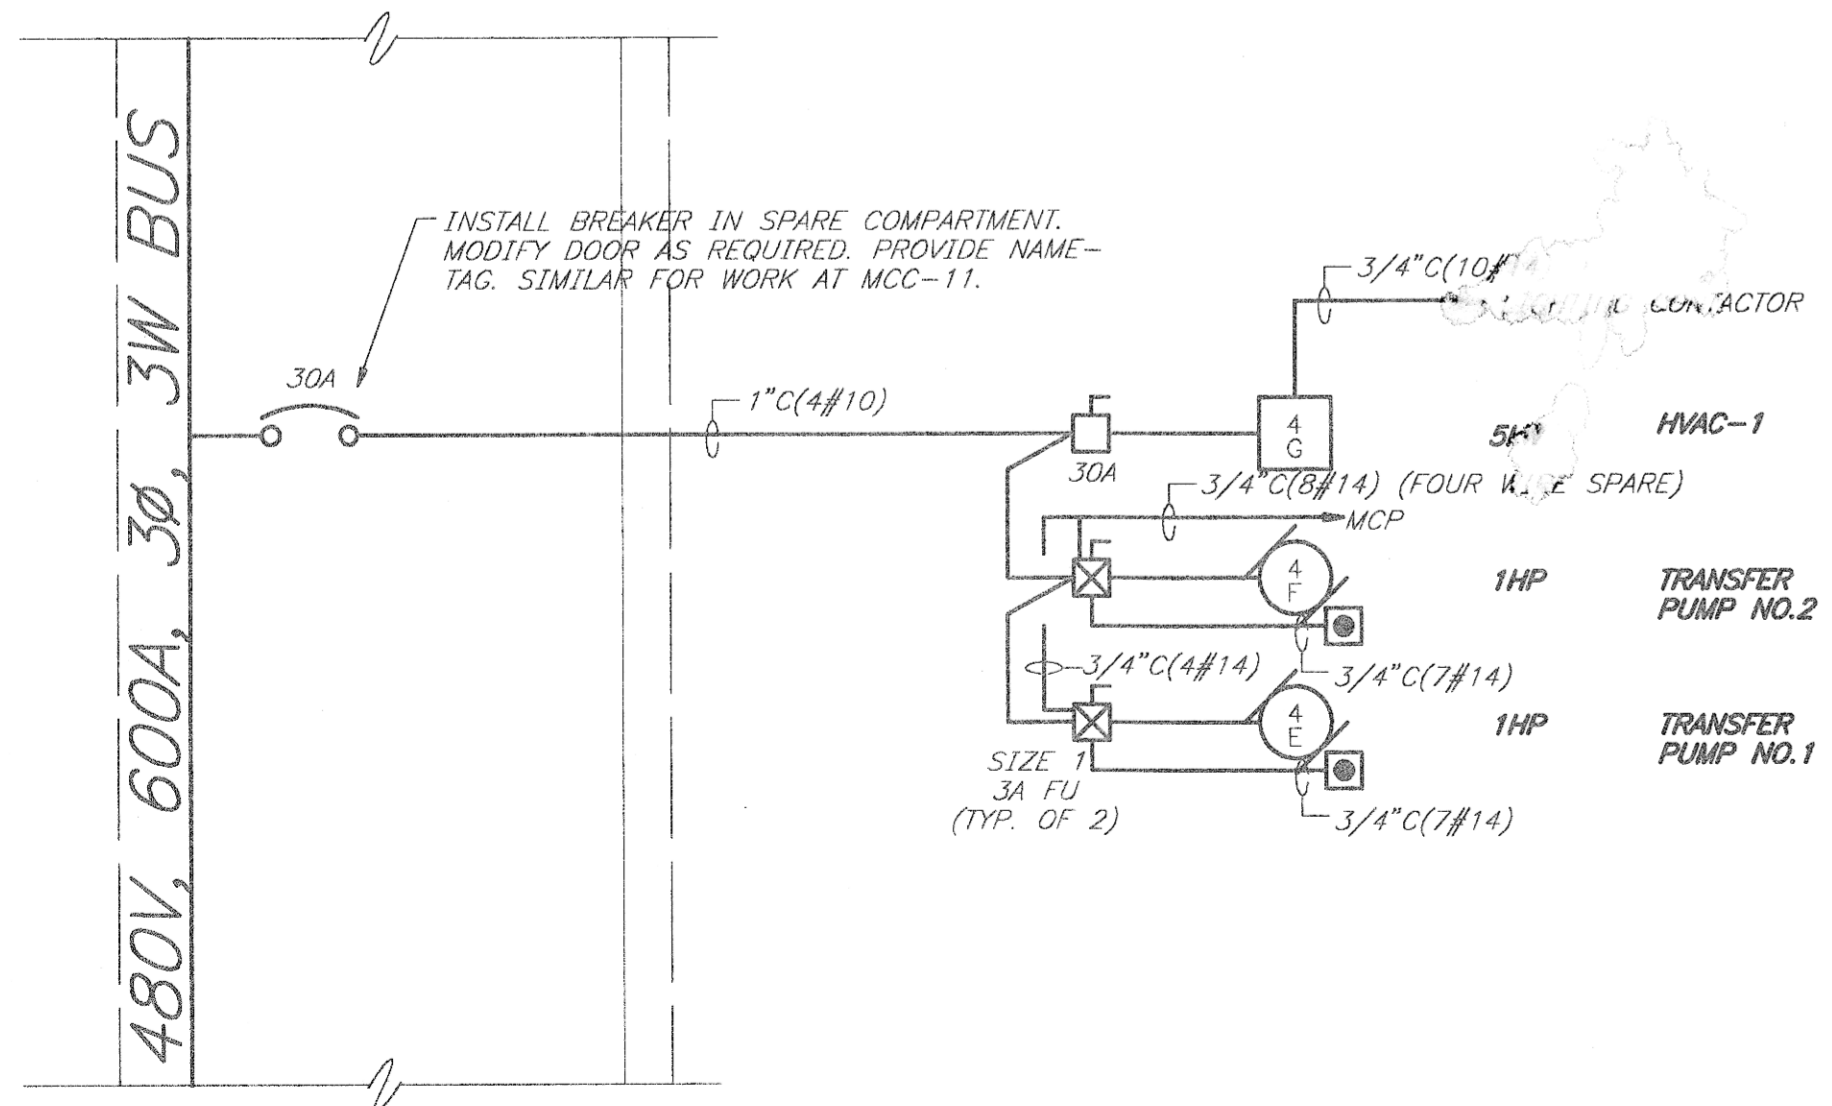

EXISTING MCC-4 PARTIAL ONE-LINE
LOCATED IN GENERATOR BUILDING

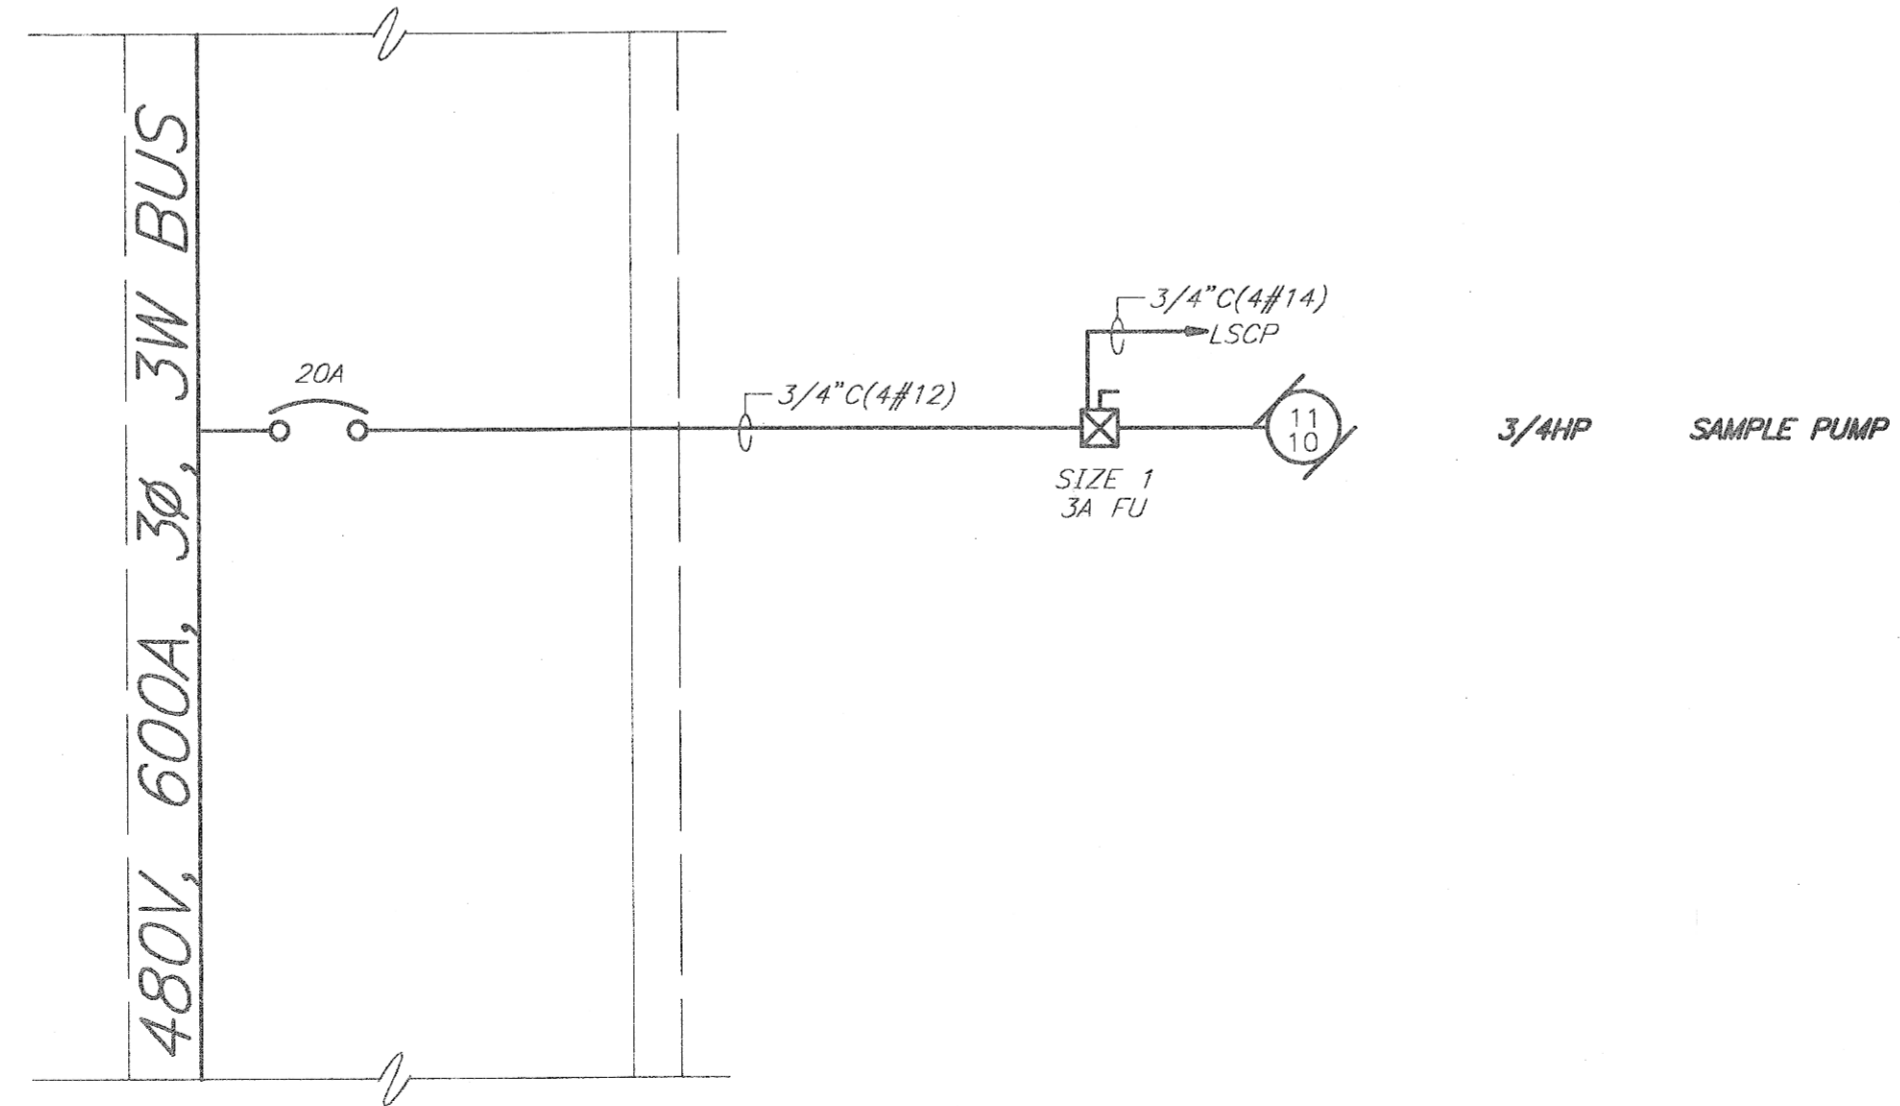

EXISTING MCC-11 PARTIAL ONE-LINE
LOCATED IN LOW SERVICE PUMP STATION

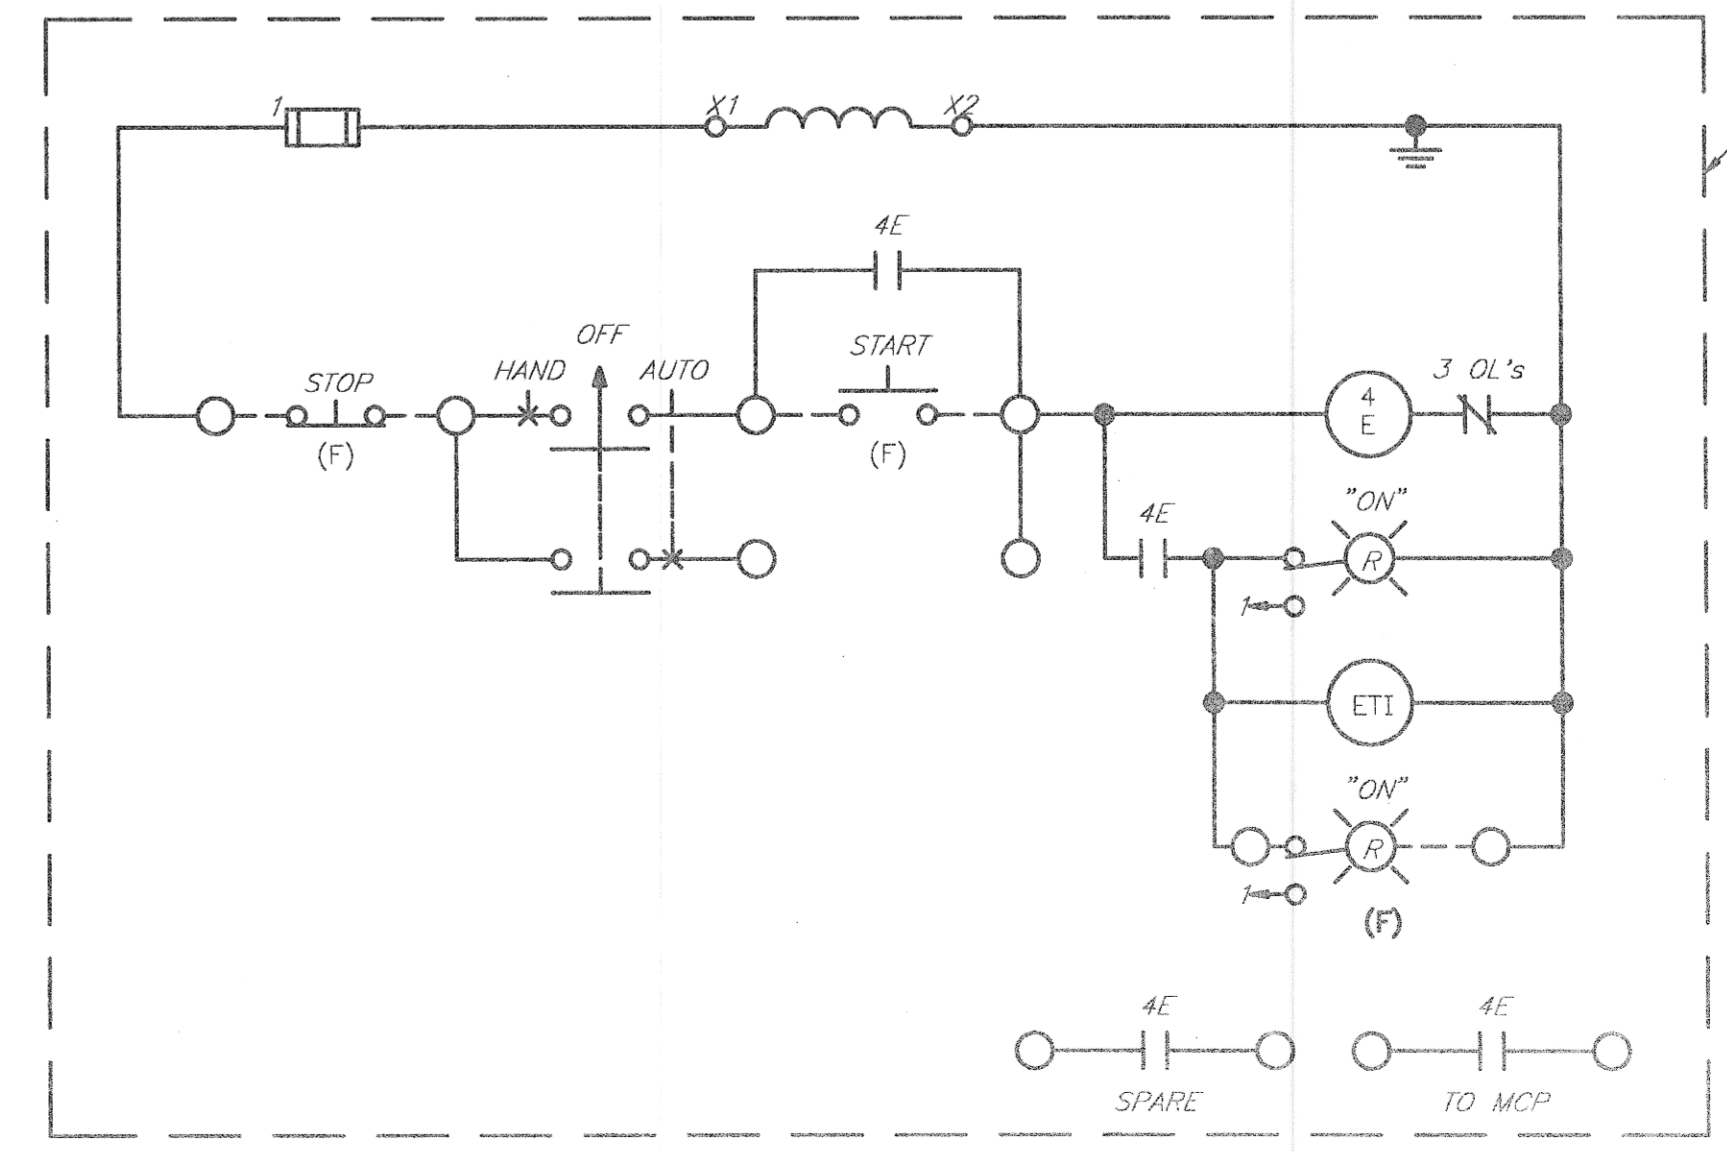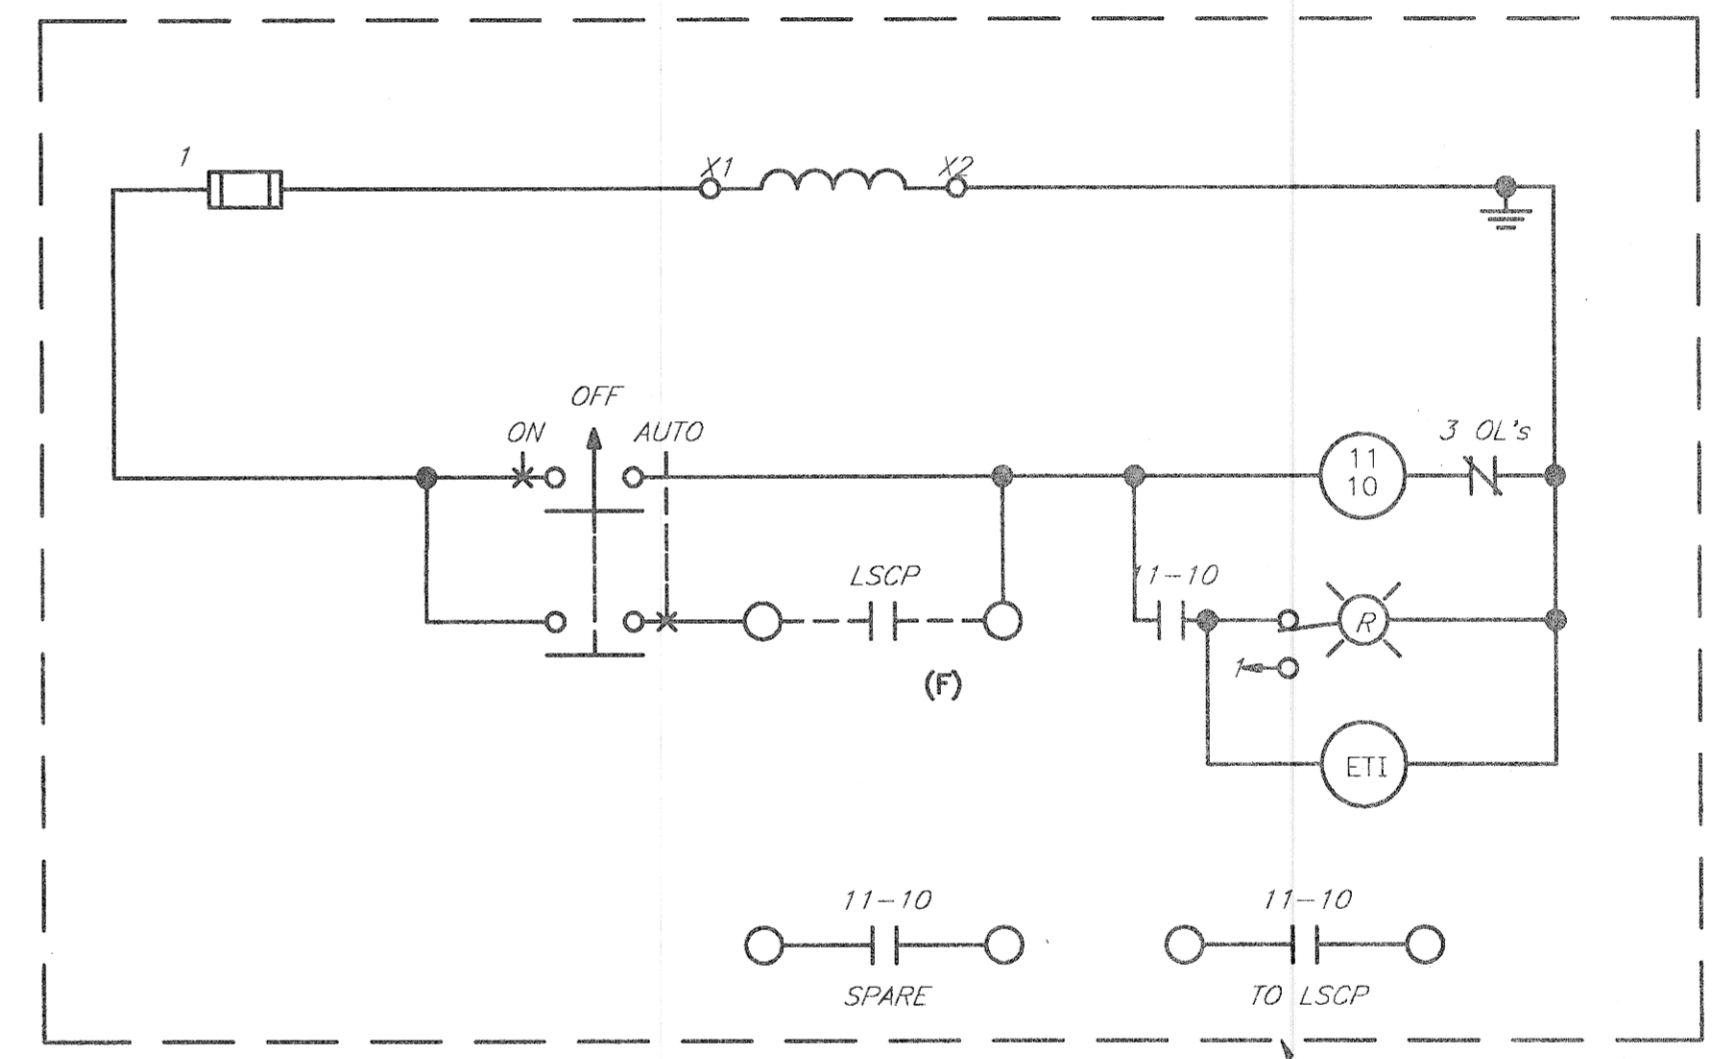

Ann Arbor, Michigan		 M&M ENGINEERING EXCELLENCE SINCE 1984
DESIGNED: G. JONES		
CHECKED: T. RITTER		
SCALE: NO SCALE		
PART: 02/MS/0225/01430/L/P/D		
CITY OF TRAVERSE CITY, MICHIGAN		
WATER TREATMENT PLANT IMPROVEMENTS		
SODIUM HYPOCHLORITE SYSTEM ADDITION		
ELECTRICAL INSTRUMENTATION		
P&ID AND DETAILS		
DIVISION:	CONTRACT:	SHEET:
	225.14-W-2(R)	EI-4
		OF 6