

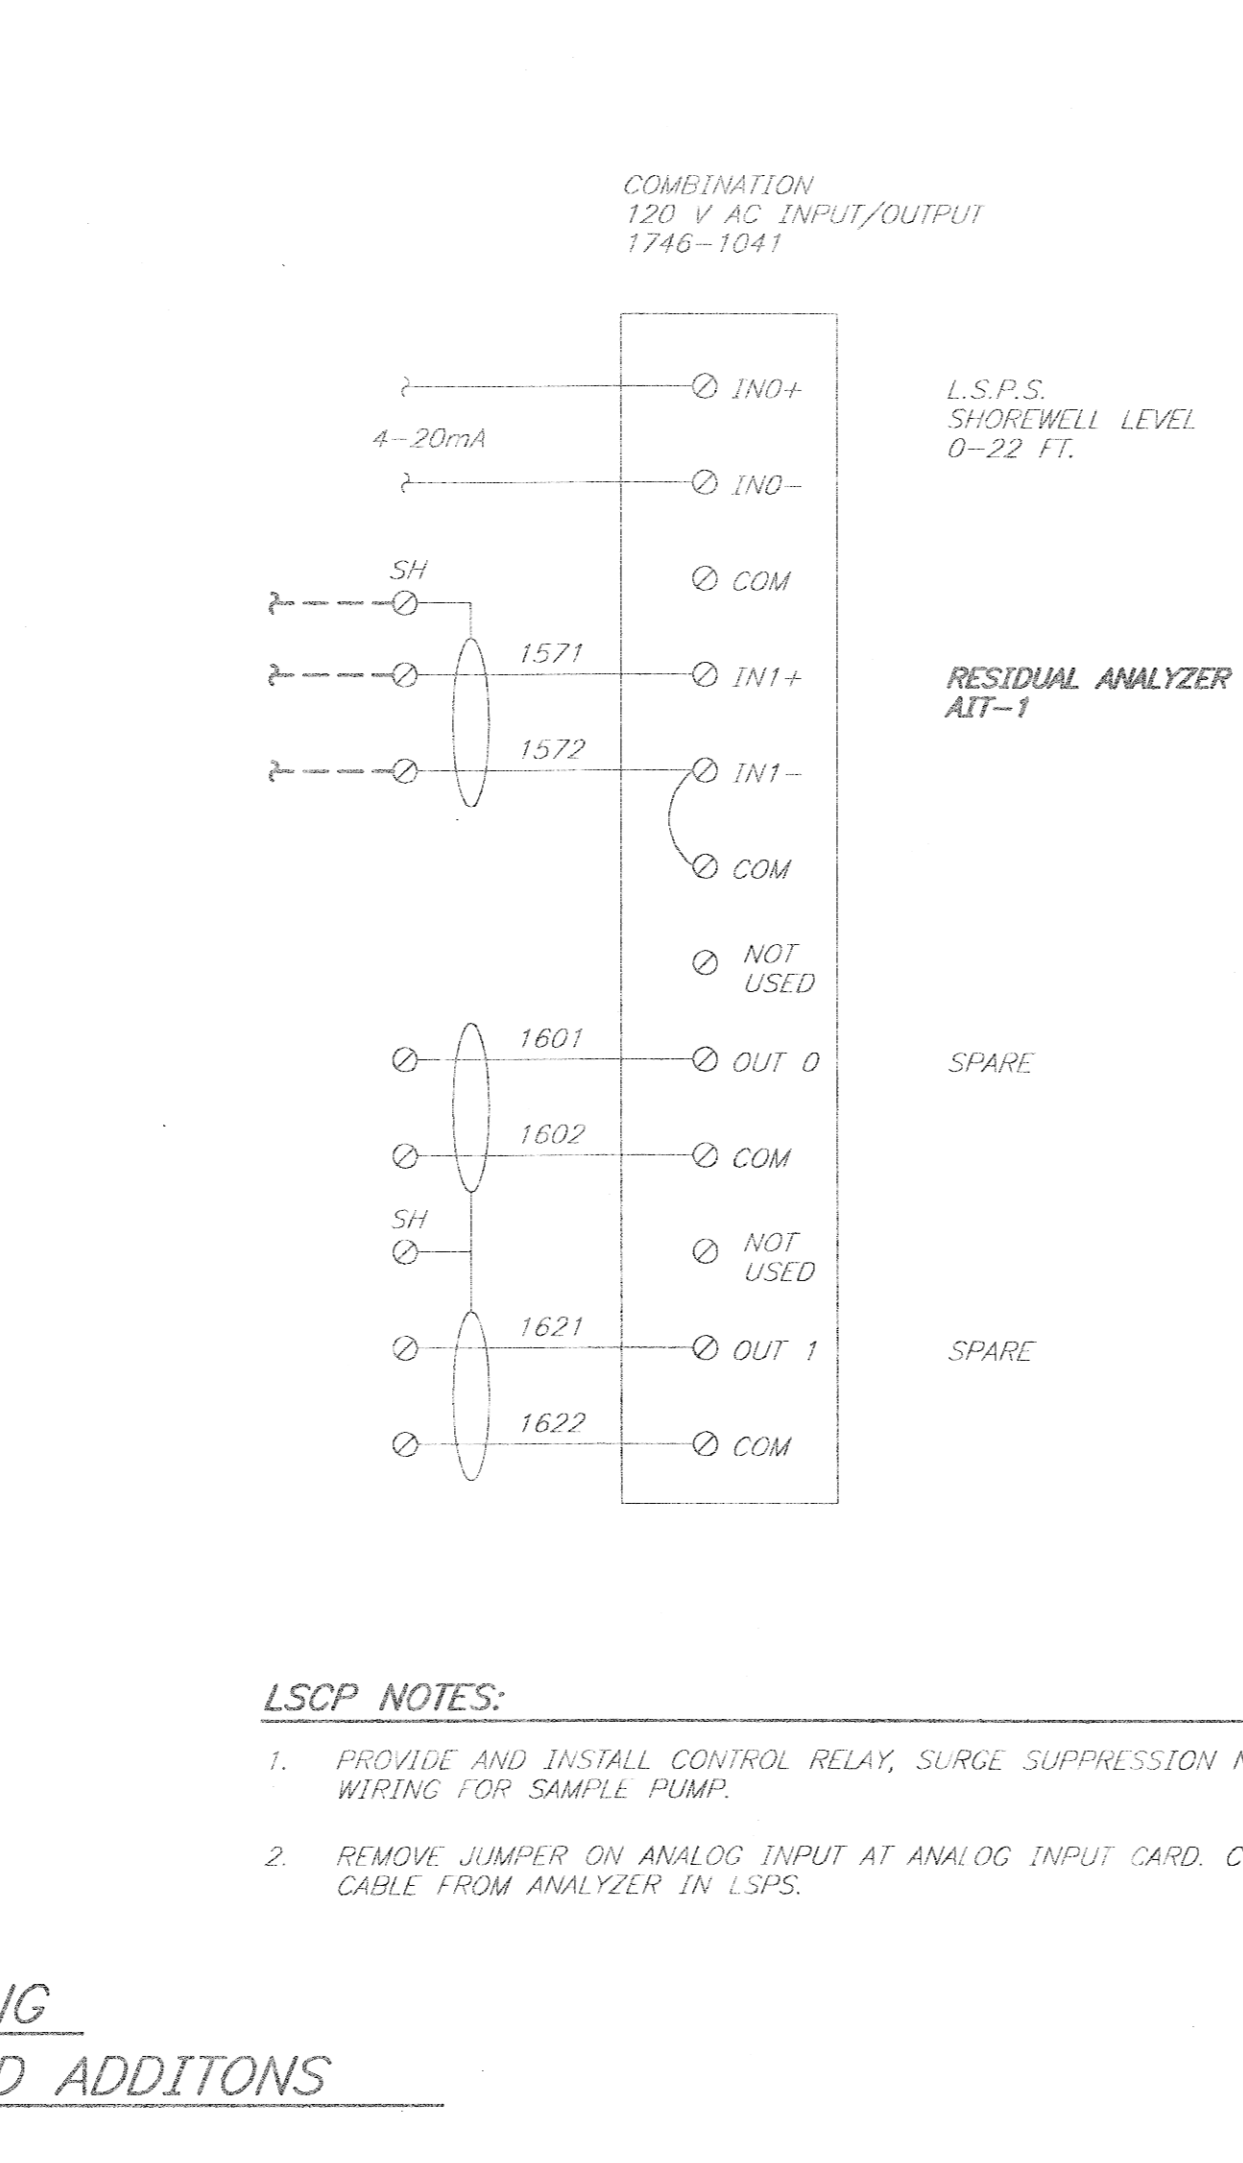


REV	DESCRIPTION	BY	DATE	CHKD
1	ISSUED FOR REBID		1/9/95	
2				
3				
4				

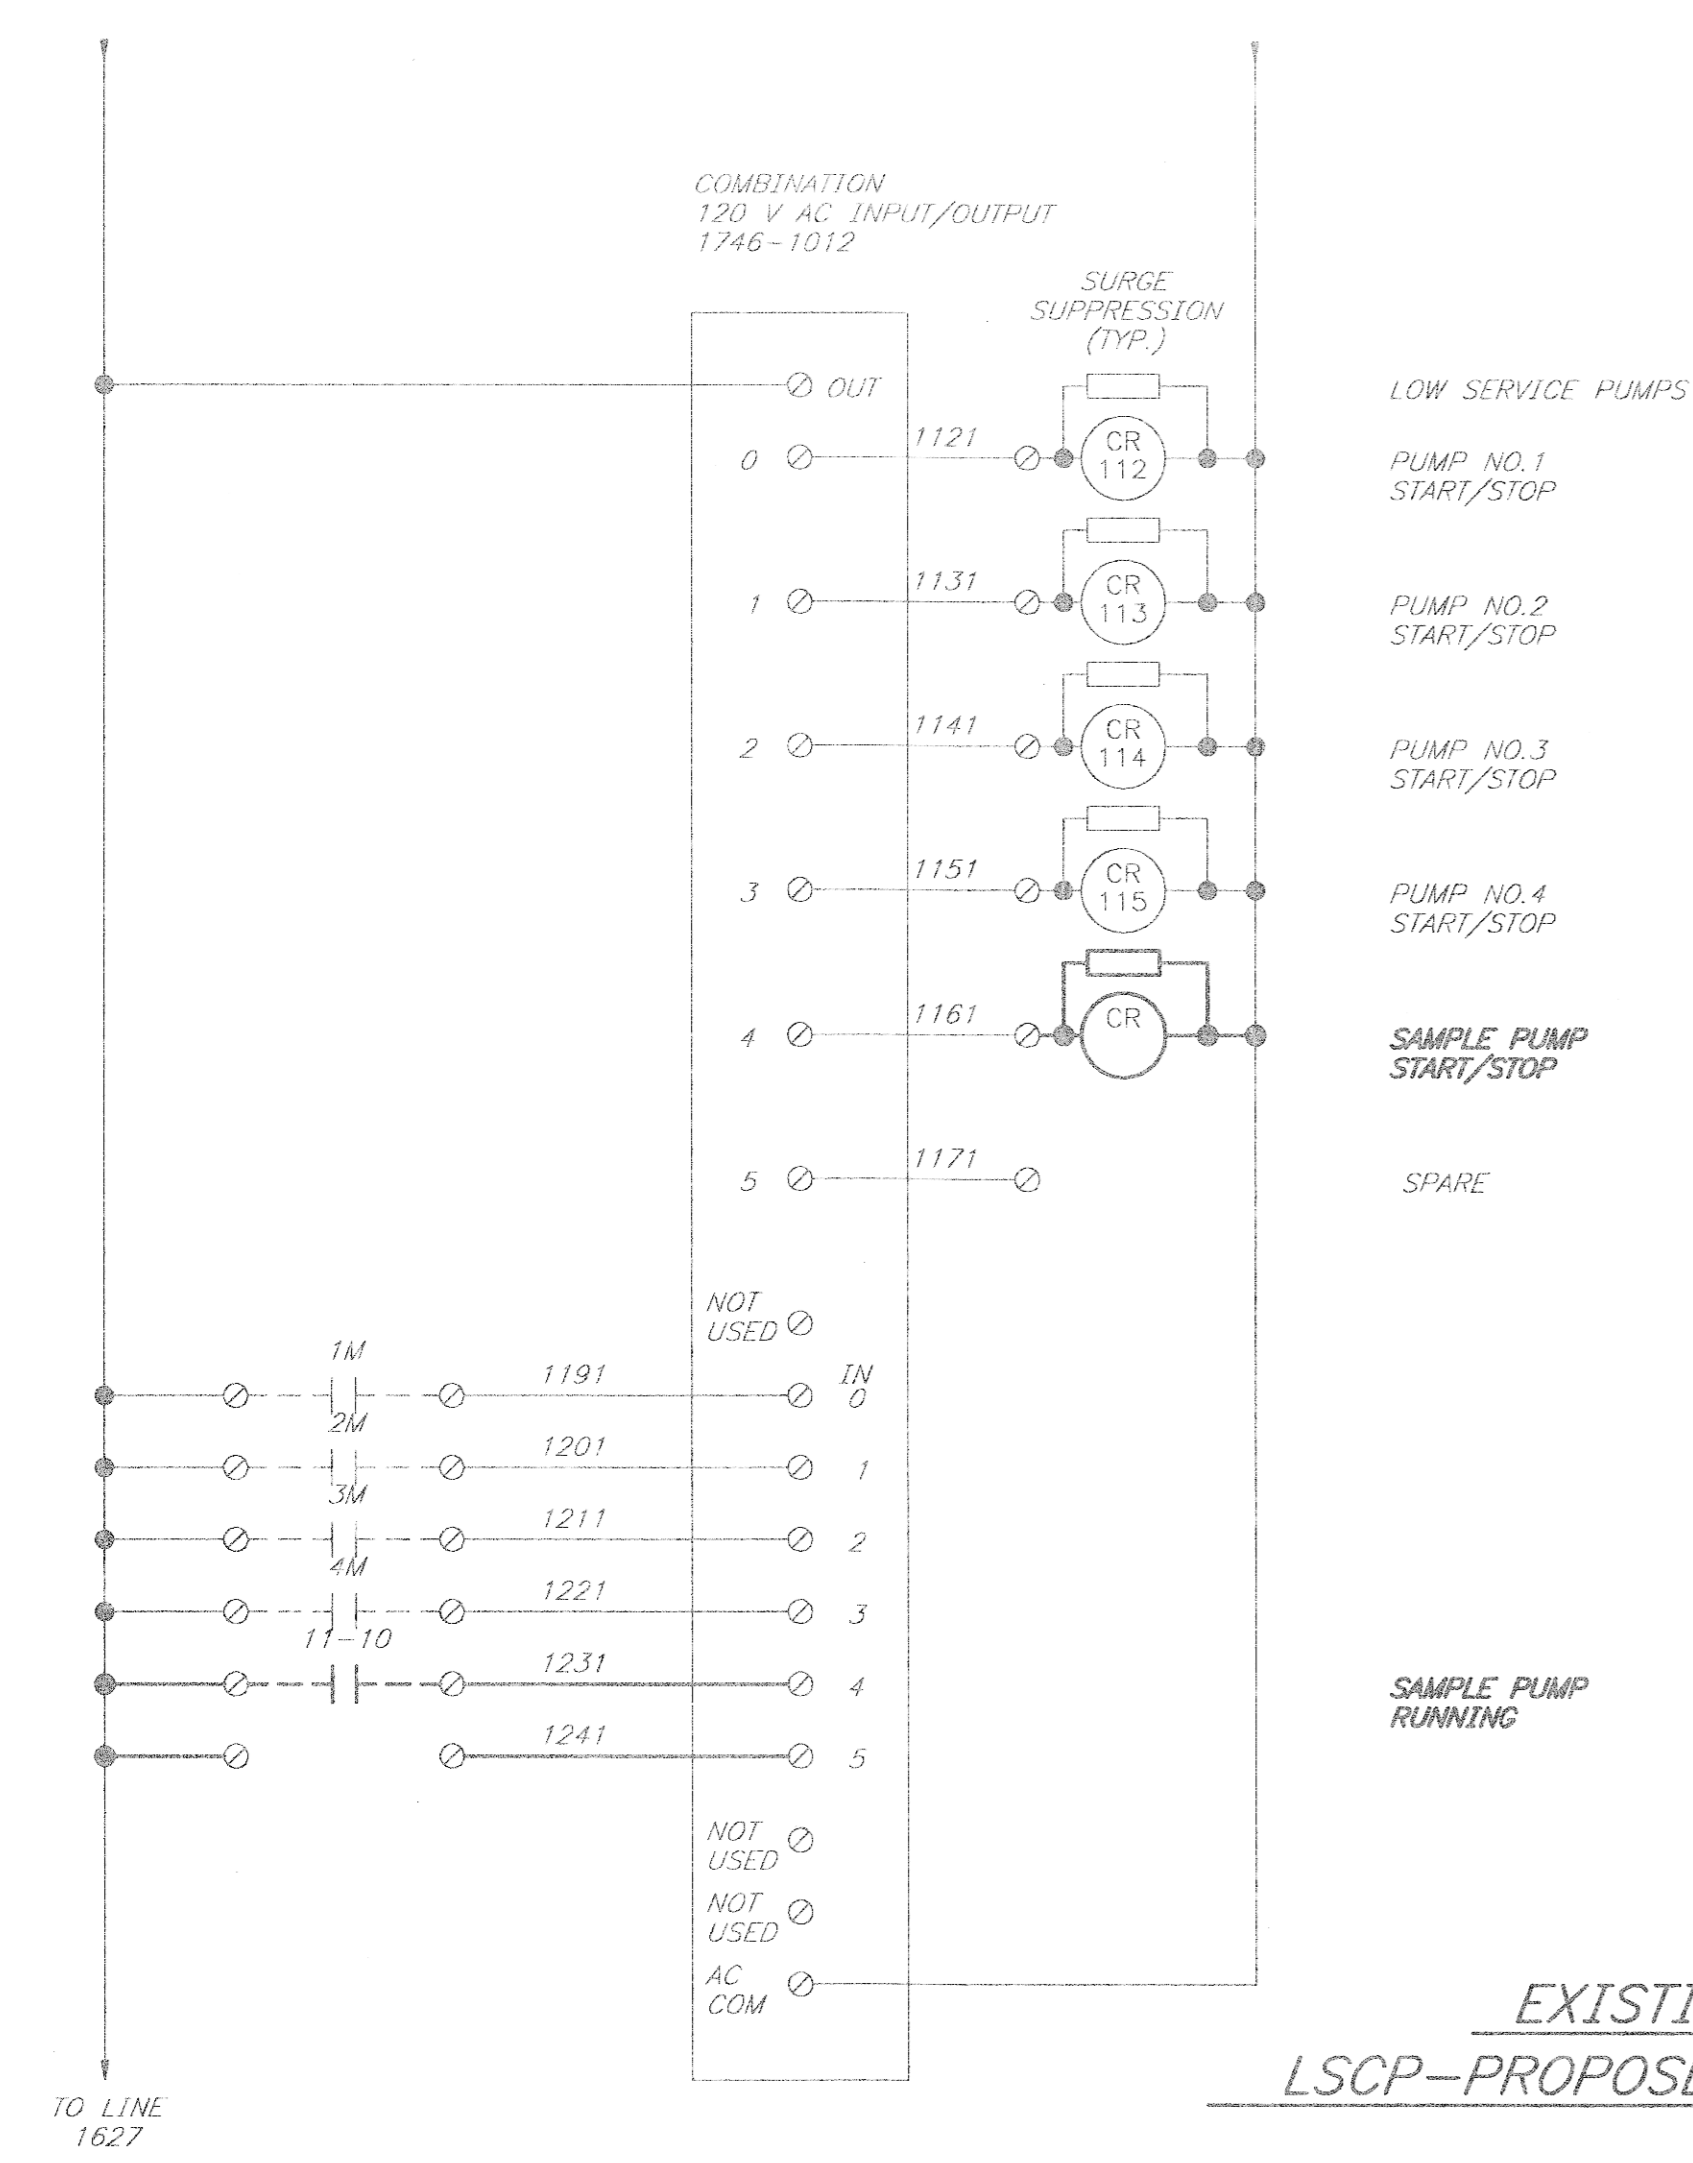


- LSCP NOTES:**
1. PROVIDE AND INSTALL CONTROL RELAY, SURGE SUPPRESSION NETWORK AND WIRING FOR SAMPLE PUMP.
 2. REMOVE JUMPER ON ANALOG INPUT AT ANALOG INPUT CARD. CONNECT SHIELDED CABLE FROM ANALYZER IN LSPPS.



**EXISTING
LSCP-PROPOSED ADDITONS**

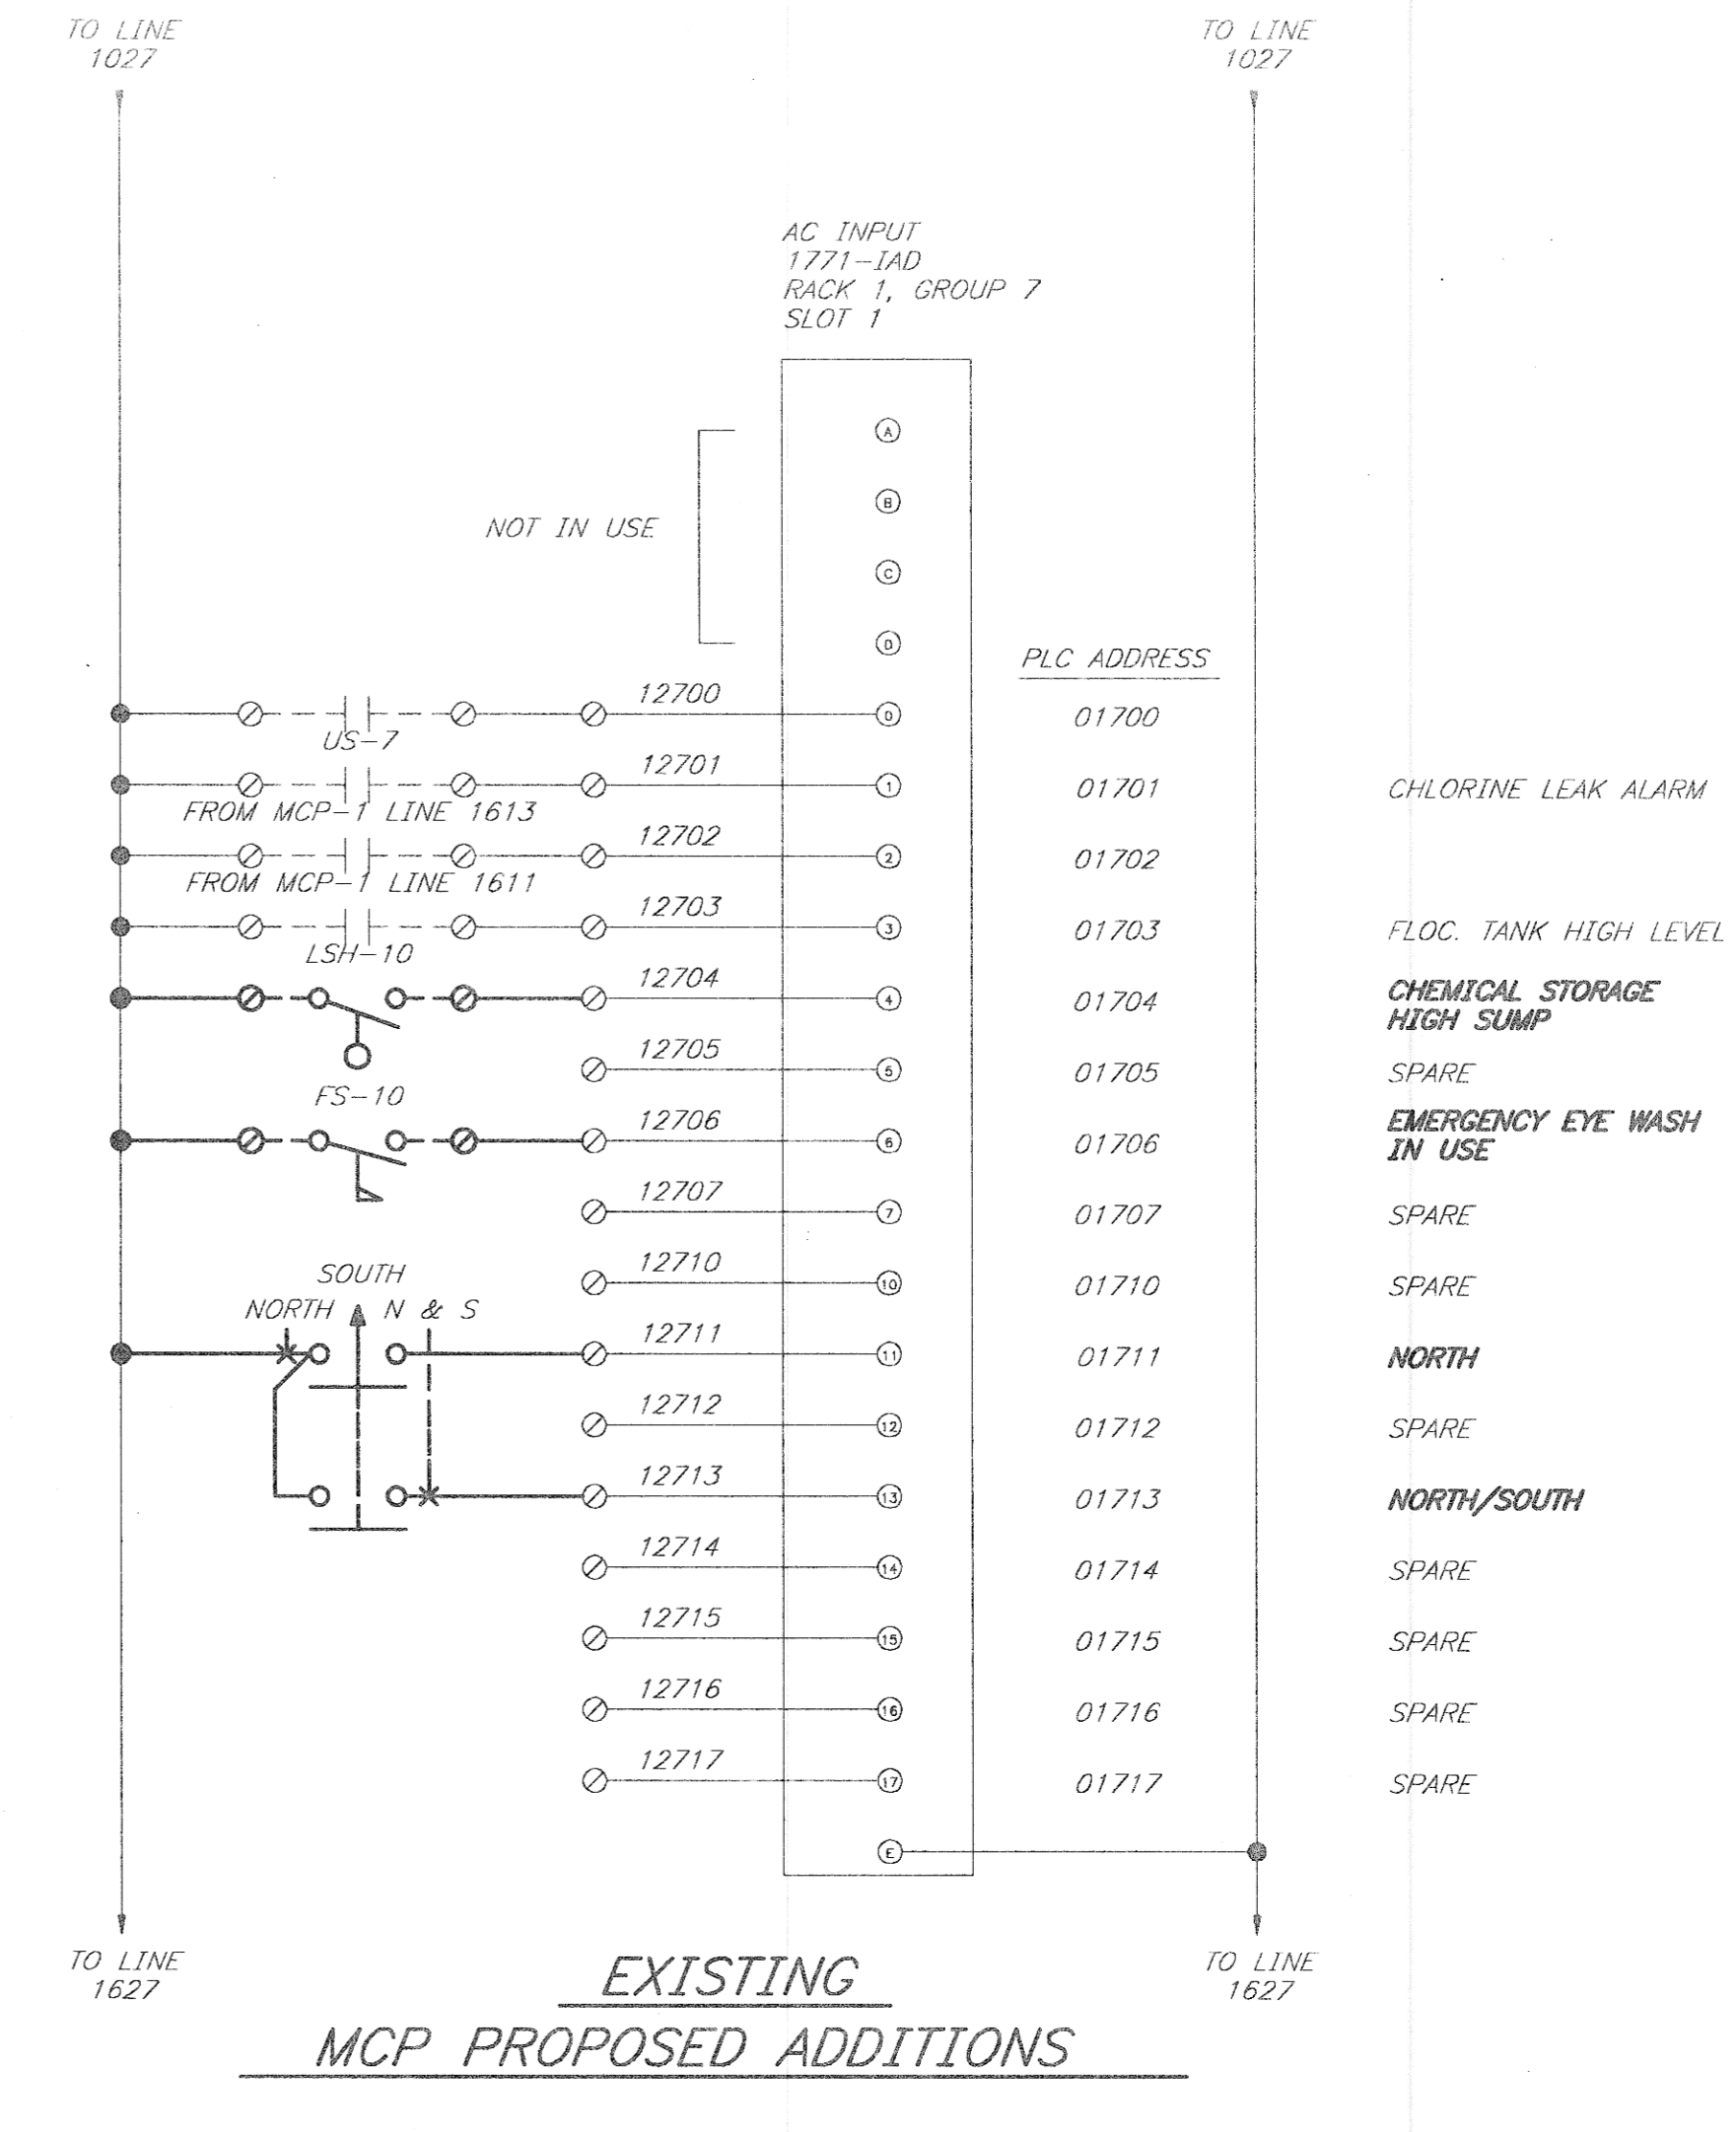

**EXISTING
MCP PROPOSED ADDITIONS**

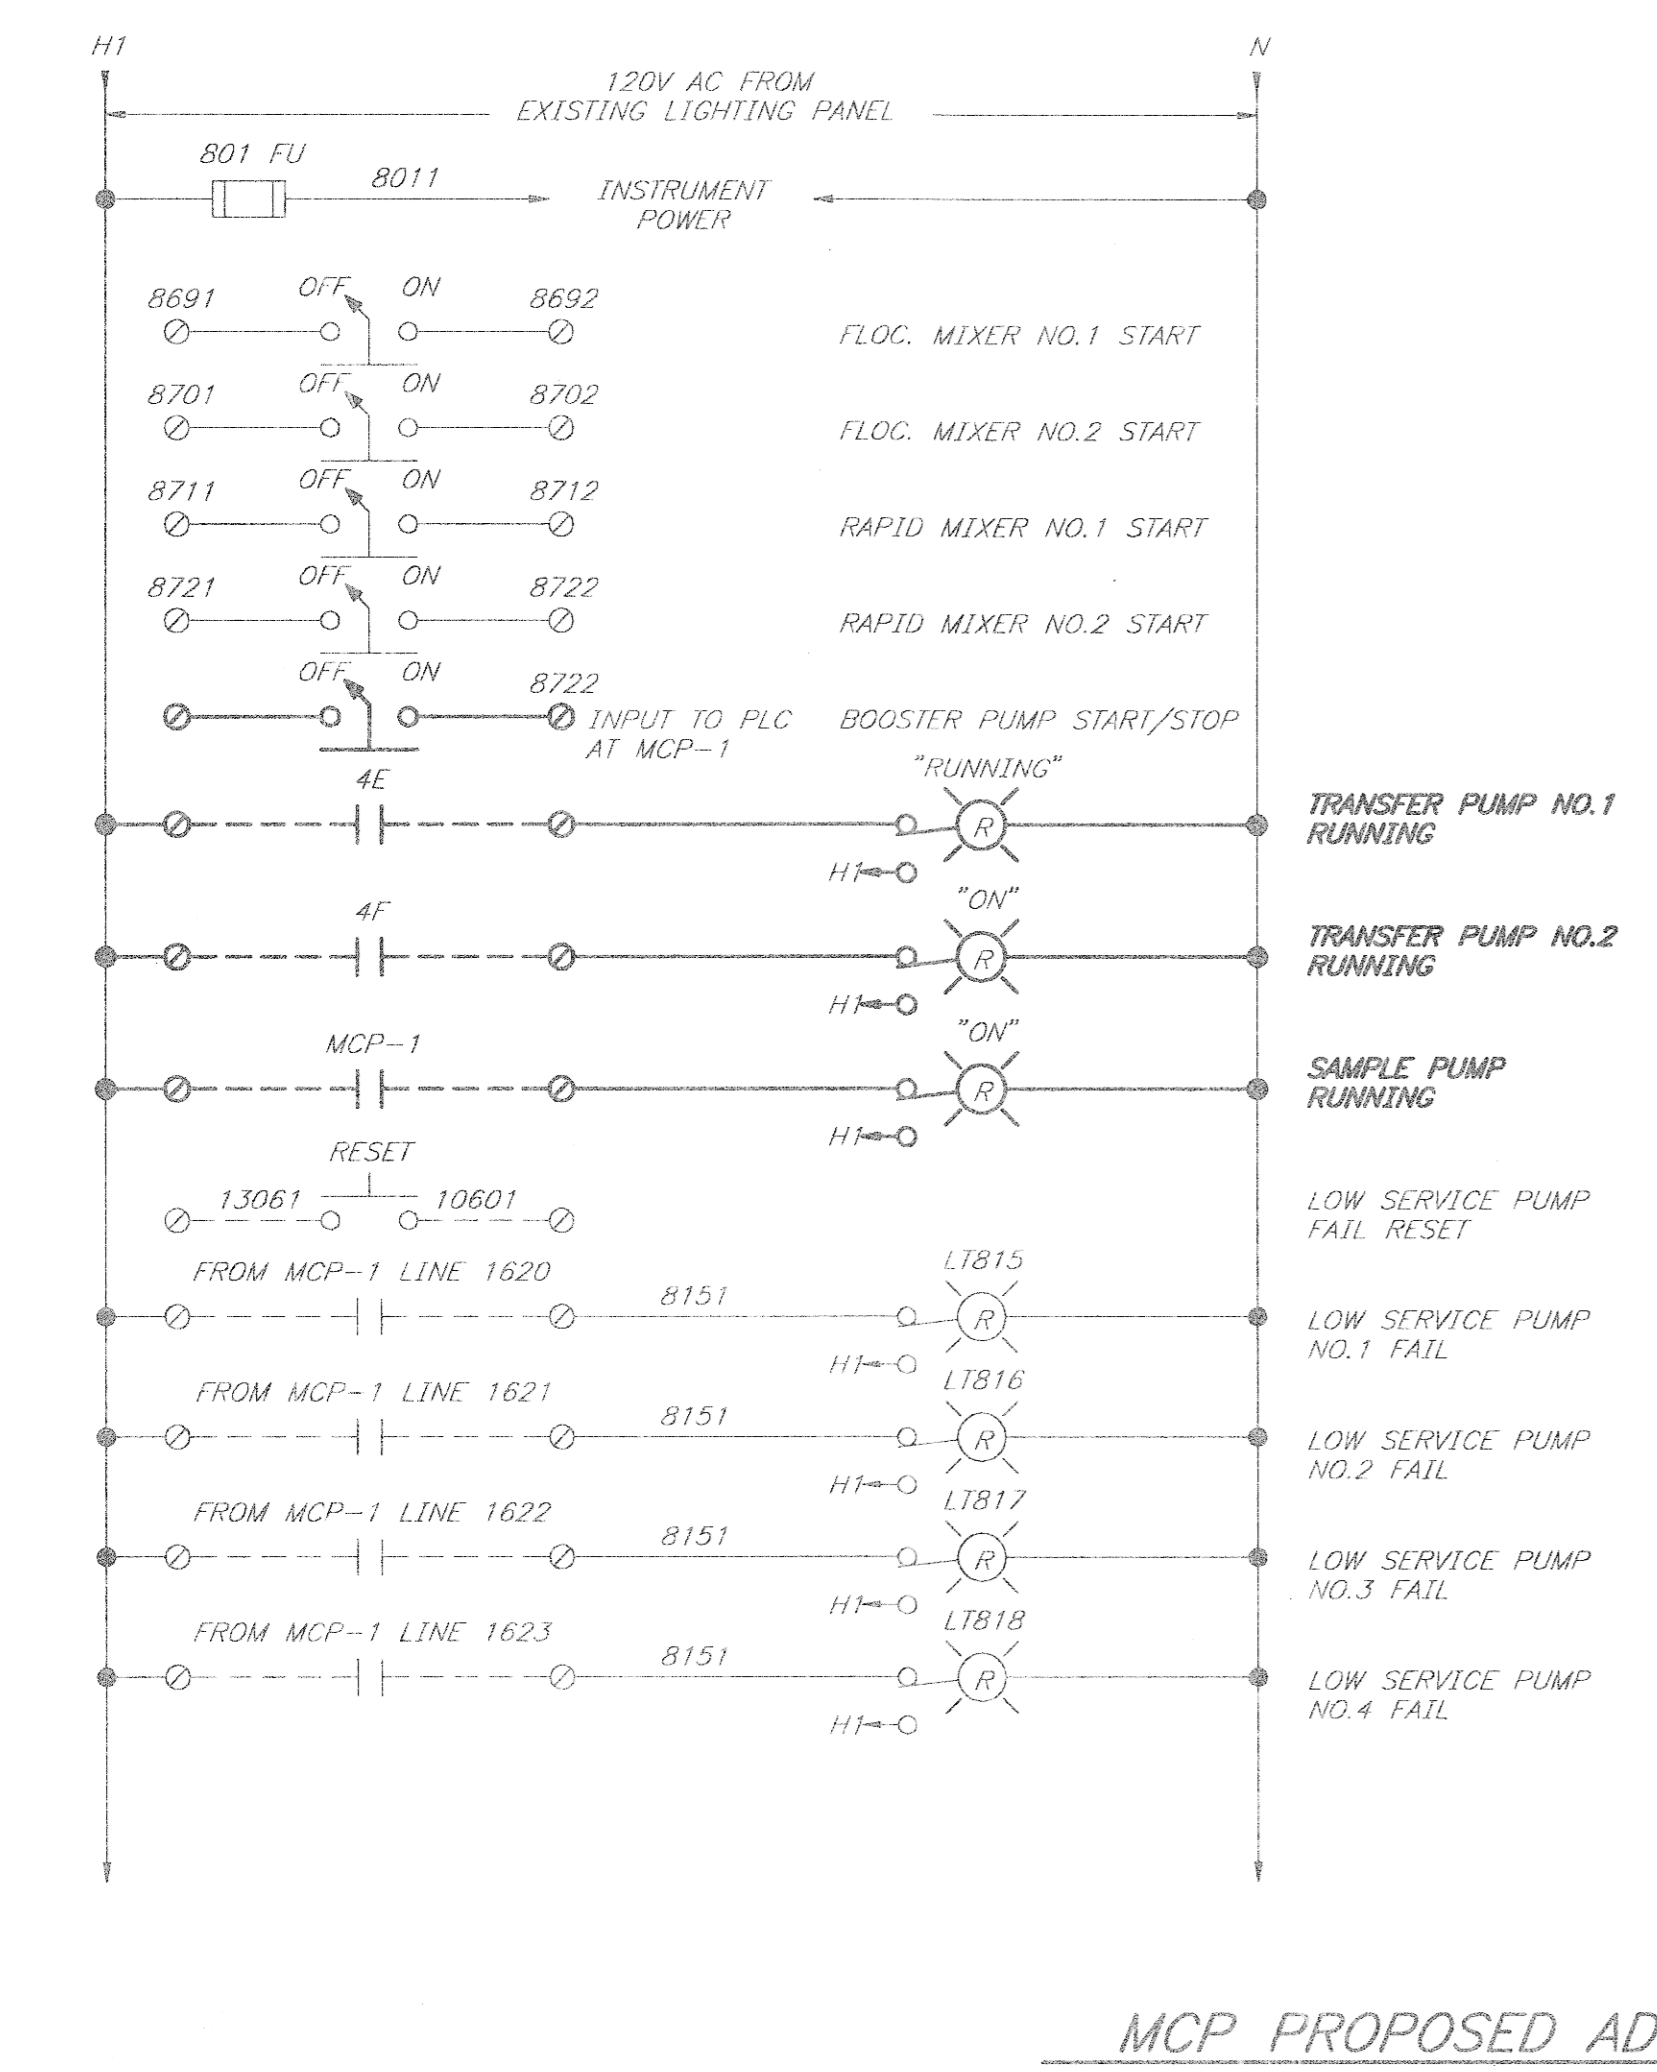

MCP PROPOSED ADDITIONS

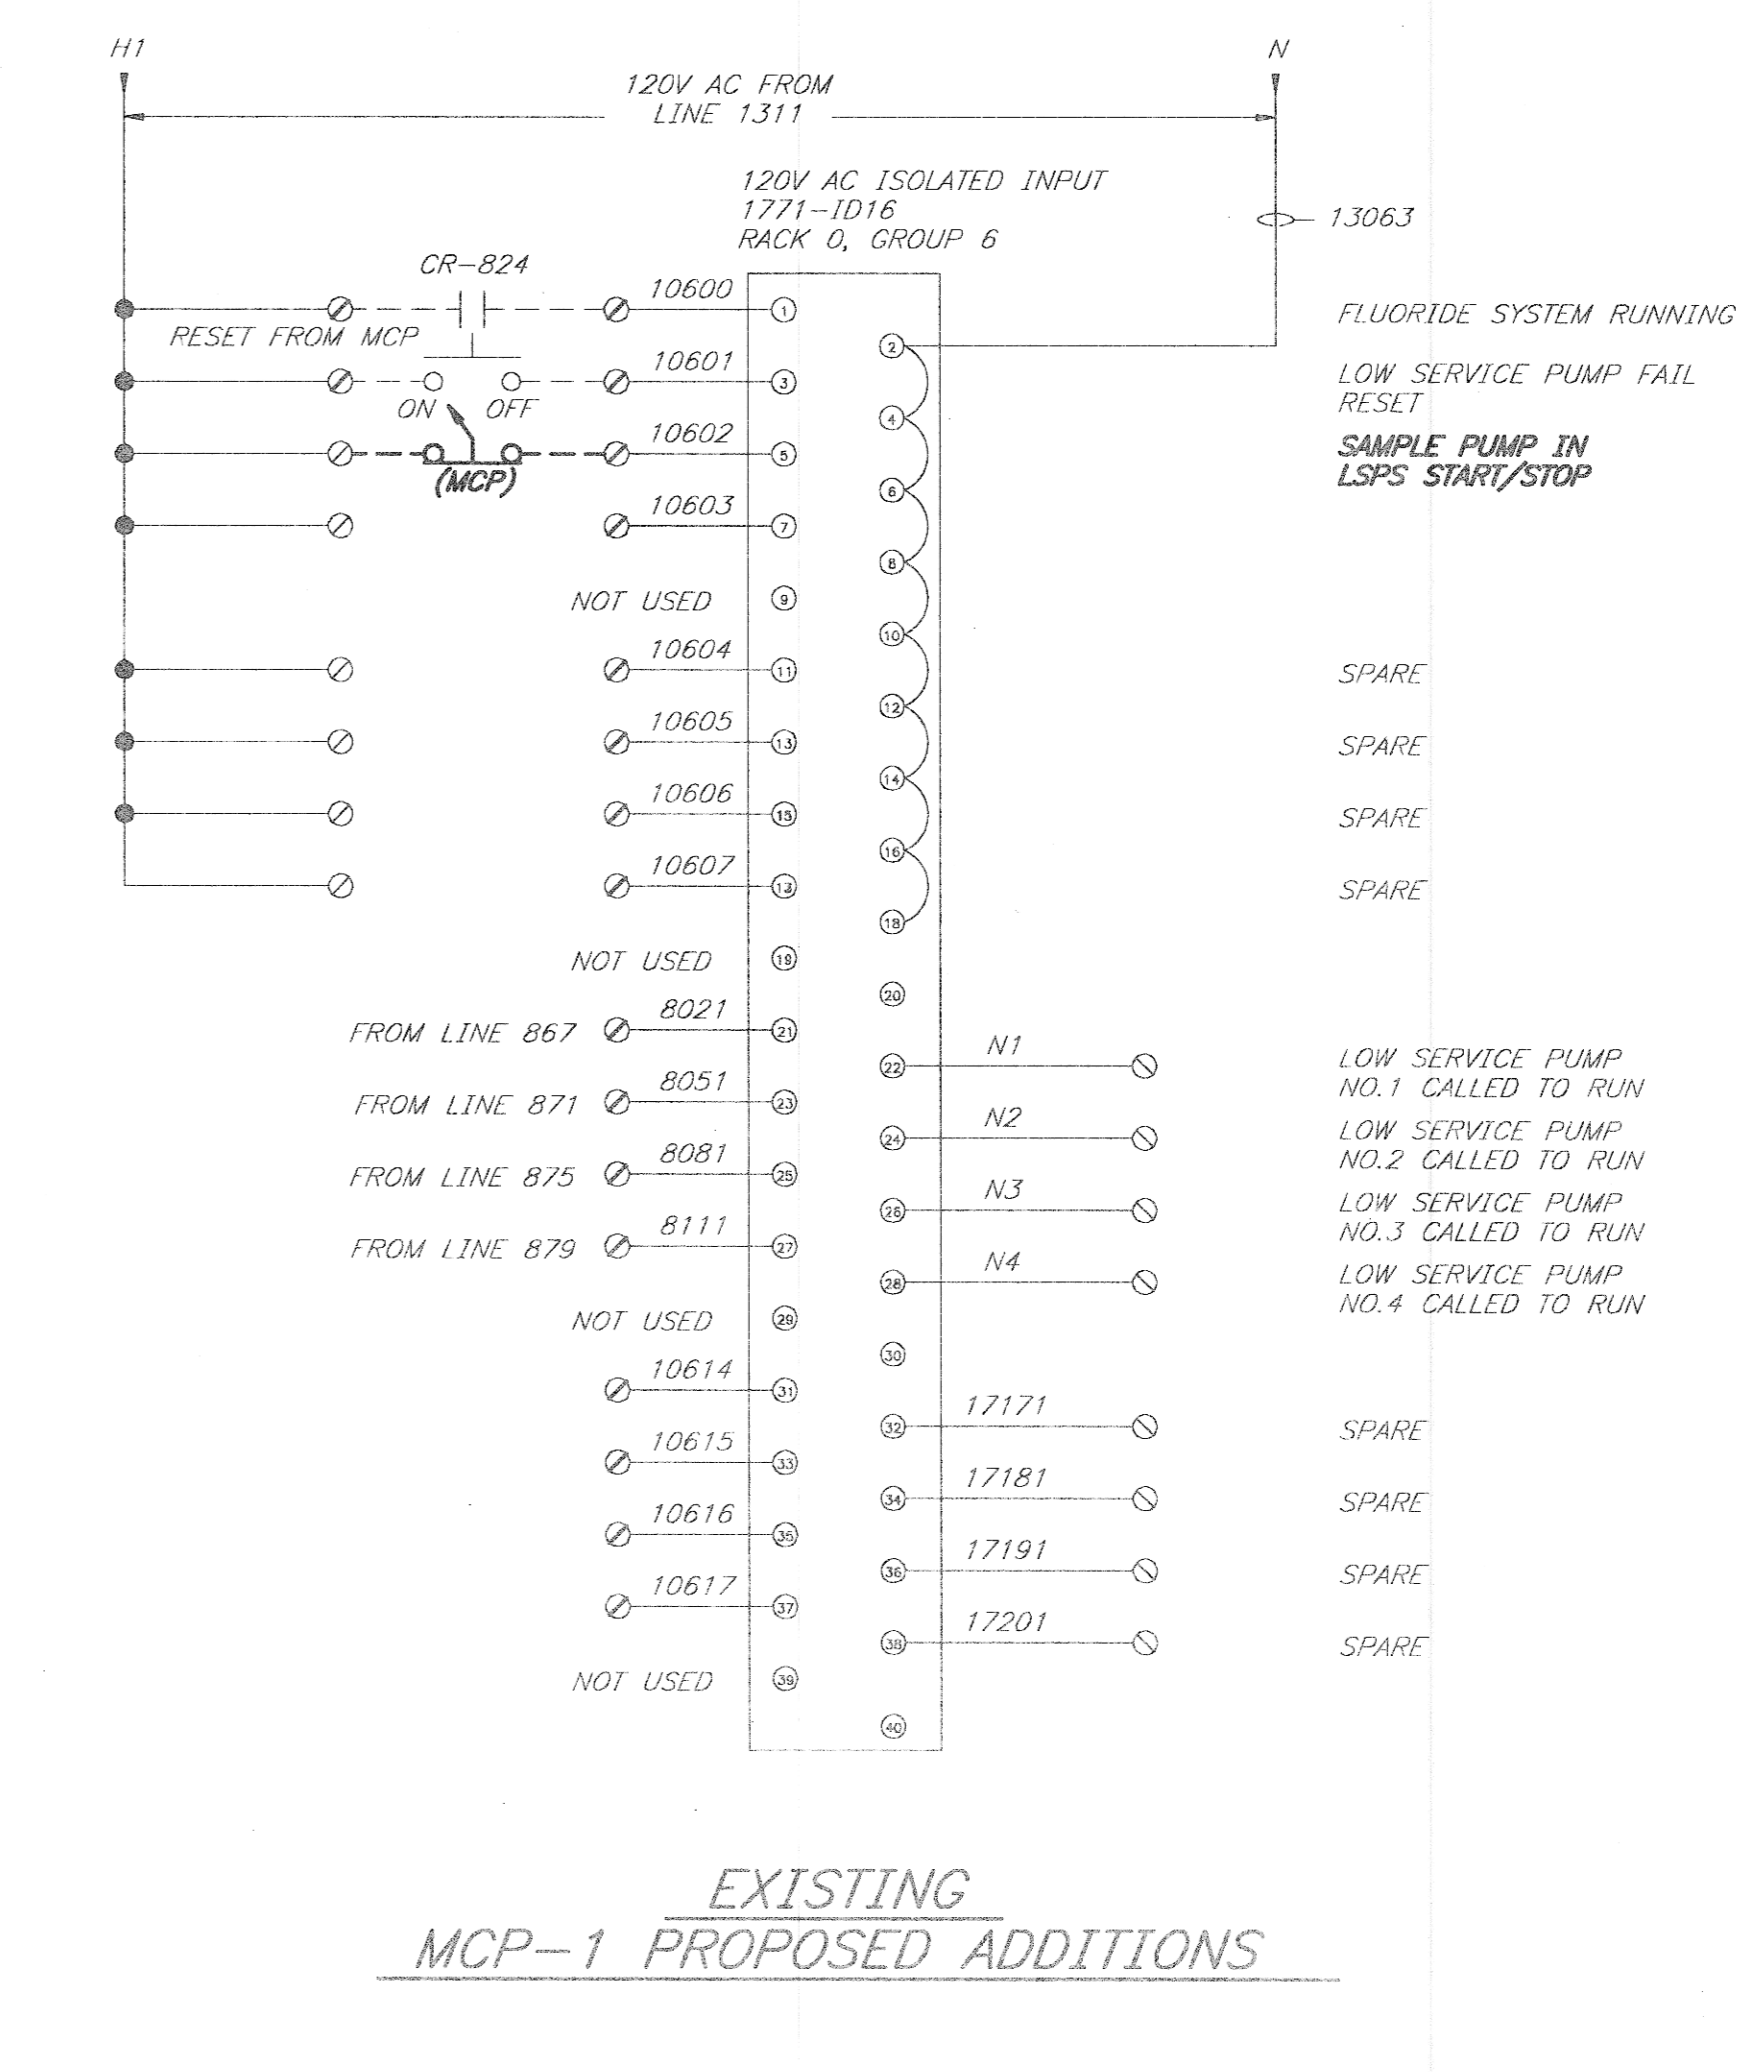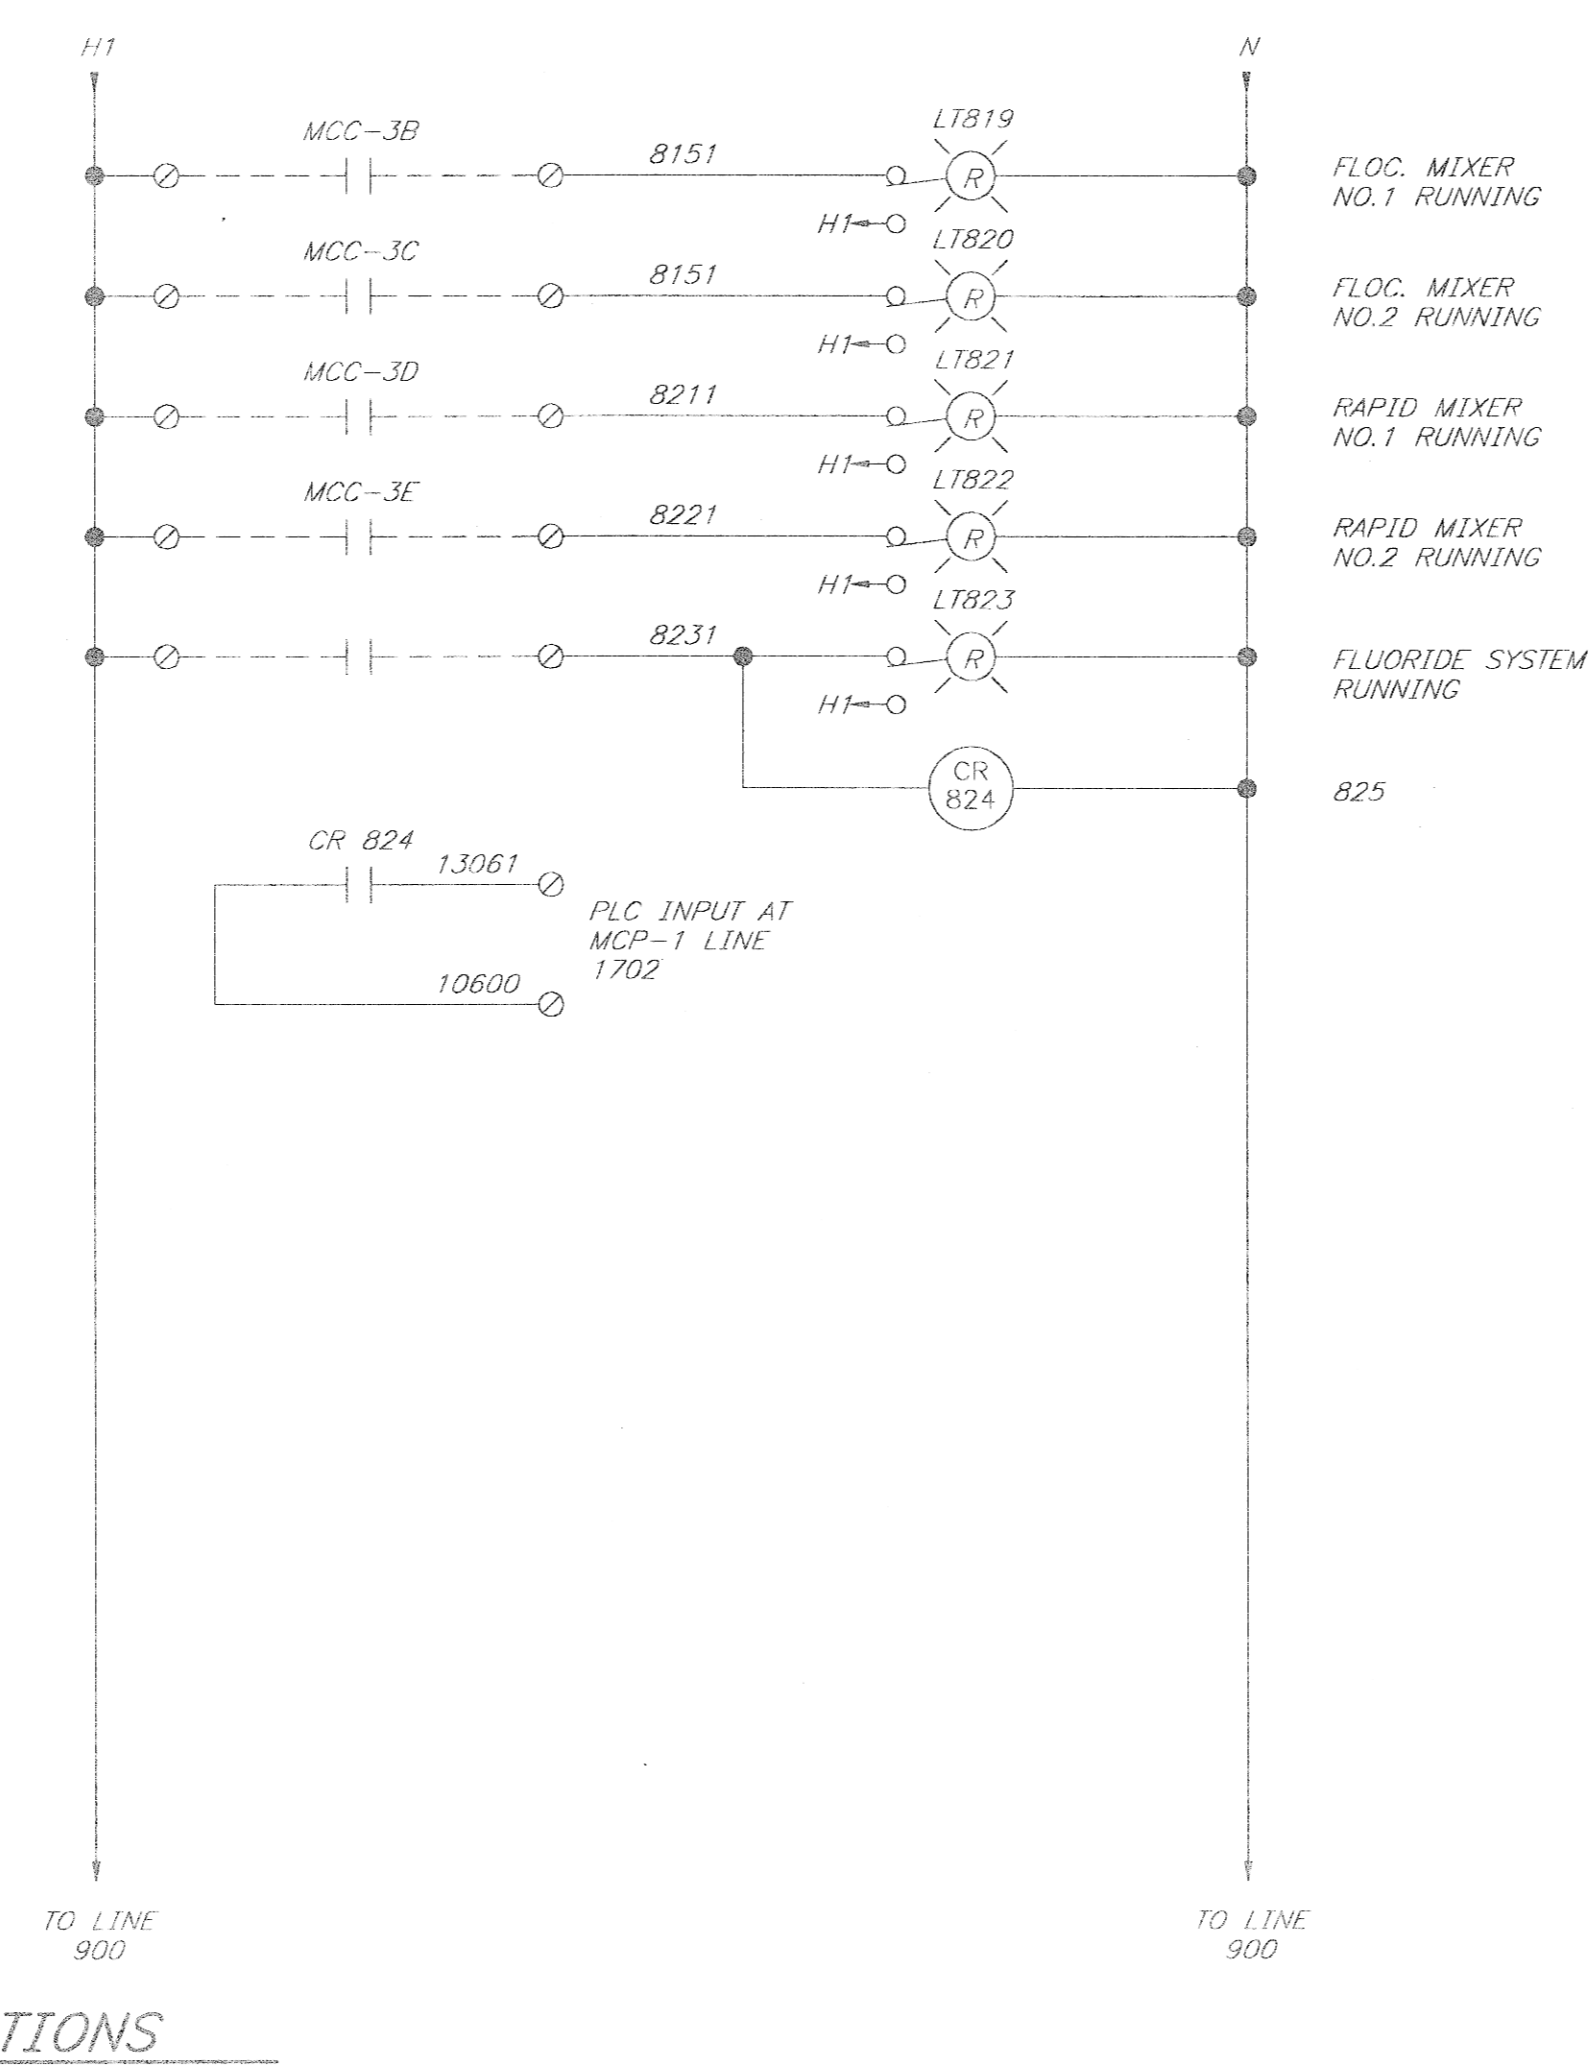

**EXISTING
MCP-1 PROPOSED ADDITIONS**

Ann Arbor, Michigan
Detroit, Michigan
Escanaba, Michigan
Grand Rapids, Michigan
Lansing, Michigan

McNamera Engineering
ENGINEERING EXCELLENCE SINCE 1941

DESIGNED G. JONES	CHECKED T. RITTER
SCALE NO SCALE	CARDI DATE 01-05-95 KOW 4
PART 0/AN/0222/01430/PLC1	
CITY OF TRAVERSE CITY, MICHIGAN WATER TREATMENT PLANT IMPROVEMENTS SODIUM HYPOCHLORITE SYSTEM ADDITION	
ELECTRICAL/INSTRUMENTATION	

DIVISION

CONTRACT

SHEET

225.14-W-2(R)

EI-6